

**University of the Built Environment
Institutional Research Repository**

Title	Effect of indoor environmental quality on visual comfort and productivity in office buildings
Author(s)	Amit Kant Kaushik, Mohammed Arif, Obas John Ebohon, Hord Arsalan, Muhammad Qasim Rana and Lovelin Obi
ORCID	
Type	Article
Publication title	Journal of Engineering, Design and Technology
Publisher	Emerald Publishing Limited
ISSN/ISBN	
Date	5 November 2023
Version	
DOI	
Repository link	https://ube.repository.guildhe.ac.uk/id/eprint/149/
Link to publication	
Notes	This publication version may differ from the final version

Copyright:

The University aims to make research outputs available to a broader audience via its digital [Repository](#). Where copyright permits, full text material held in the Repository is made freely available. URLs from GuildHE Research Repositories maybe freely distributed and linked to. Please refer to each manuscript for any further copyright restrictions.

Reuse: Copies of full items can be used for personal research or study, educational, or not-for-profit purposes without prior permission or charge provided that the authors, title and full bibliographic details are credited, a hyperlink and/or URL is given for the original metadata page, and the content is not changed in any way.



Effect of Indoor Environmental Quality on Visual Comfort and Productivity in Office Buildings

Journal:	<i>Journal of Engineering, Design and Technology</i>
Manuscript ID	JEDT-09-2021-0474
Manuscript Type:	Original Article
Keywords:	Indoor Environmental Quality, Visual Comfort, Office Building, Response Surface Analysis, Occupant Productivity

SCHOLARONE™
Manuscripts

Effect of Indoor Environmental Quality on Visual Comfort and Productivity in Office Buildings

1 Abstract

Visual environment is one of the most important indoor environmental quality parameters and directly impacts occupant productivity in offices. The literature outlines the significance of the impact. Still, there is a lack of investigation, statistical analysis, and inter-relationships between the independent variables (indoor environmental quality factors), especially in the hot and arid climate. This study presents a research study investigating the effects and shows statistical relationships between indoor environmental quality on occupant comfort and productivity. The study was conducted in the Middle East, and data were collected for 12 months. It used the Response Surface Analysis to perform analysis. It outlined seven unique relationships highlighting the recommended range, inter-dependencies. Results include that illumination has maximum effect on visual comfort and temperature, daylight having direct influence and relative humidity, wall type next to the seat and kind of workspace also have an impact on visual comfort and productivity. These findings would help to improve occupant comfort and productivity in office buildings. It is recommended to include results and recommendations on design guidelines for office buildings. This paper presents the unique effects of non-visual indoor environmental quality parameters on visual comfort and productivity. This investigation also provides a unique method to develop the statistical relationship between various indoor environmental factors and productivity in different contexts and buildings.

Keyword: Indoor Environmental Quality, Visual Comfort, Office Building, Response Surface Analysis

Article Classification: Original Research Paper

2 Introduction

People spend most of their hours indoors based on their job requirement, season, and age (Al-Esia and Skok, 2015; ASHRAE, 1993; Hailu, Gelan and Girma, 2021). Most of the urban population work in an indoor working environment (Bluyssen *et al.*, 1996). An efficient and healthy working environment is essential and fundamental for all the occupants to work efficiently and productively (Mawson, 2002; Bueno, de Paula Xavier, Antonio Augusto and Broday, 2021). Indoor environment quality substantially affects occupant comfort and productivity (Humphreys, 2005; Abbaszadeh *et al.*, 2006;

Hassanain, 2007; Geng *et al.*, 2017). Physical indoor environment quality consists of thermal comfort, indoor air quality, visual comfort, and audio comfort of the indoor space (Fisk, W. J. *et al.*, 1999; Djongyang, Tchinda and Njomo, 2010; Peretti and Schiavon, 2011; Kaushik *et al.*, 2020). All these I.E.Q. factors and comfort contribute to the overall comfort of the occupant and, thus, productivity (Figure – 1) (Fisk, William J., 2000b; Nicol and Humphreys, 2002).

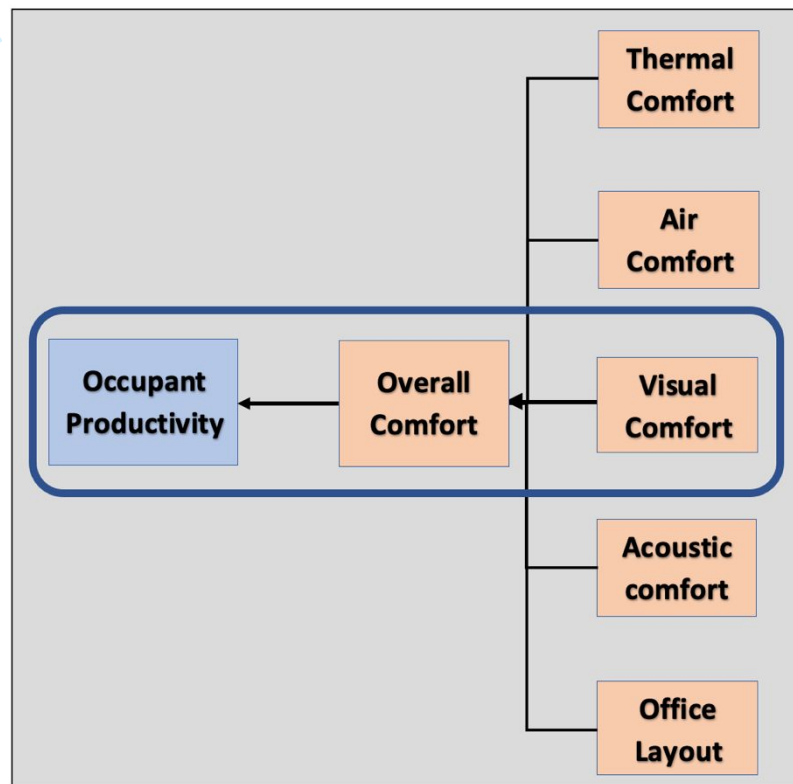


Figure 1 - Comfort and Productivity

Comfort is a prerequisite for productivity, but comfort doesn't always lead to productivity. Most building guidelines focus on comfort and but don't explicitly aim for productivity. Studies show that thermal and indoor air comfort has the highest share of impact on occupant comfort and productivity (Kaushik *et al.*, 2020; Lin and Deng, 2008; Mujan *et al.*, 2019). Nonetheless, visual comfort or lighting levels also directly influence occupant health and significantly impact indoor occupant comfort and productivity (Yun *et al.*, 2012; Li and Tsang, 2008; Gou, Lau and Ye, 2014). Visual comfort is a fundamental need for office employees to perform their tasks efficiently and have good health. Efficient indoor environmental and productive occupants can substantially affect an organisation's financial performance (Fisk, William J., 2011; Fisk, William J., 2000a; Fisk, 2000). Numerous studies have highlighted the direct

1
2
3 impact of quantity and quality of light on human health (Boyce, Peter R., 1997;
4 Osibona, Solomon and Fecht, 2021). It is crucial to investigate the effect of visual
5 comfort on occupant comfort and productivity.
6
7

8
9 This study aimed to underline the statistical relationship between lighting level and
10 occupant comfort and productivity. It also focused on identifying any direct or indirect
11 relationship non-visual parameters on visual comfort and product. The study was
12 conducted by collecting physical parameters of an indoor environment in an office in
13 a subtropical desert climate. The data was analysed using Response Surface
14 Methodology to define the relationships.
15
16
17
18

19
20 The rest of the paper is divided into five sections. The following section presents a
21 literature review on lighting and daylighting and a discussion on indoor lighting
22 measurements. The second section offers the design of the experiment. It highlights
23 the research structure, including the survey design, data collection strategy and data
24 analysis. The third section presents the study results, including Analysis of Variance
25 (ANOVA), Regression Analysis, relationship equation and graphs. The fourth section
26 discusses the results and their implications for building design. The last section
27 presents the conclusion of the study.
28
29
30
31
32
33
34

3 Lighting and Daylighting (Visual Comfort)

35
36
37 Visual comfort influences occupant comfort and satisfaction within an indoor
38 environment (Frontczak and Wargocki, 2011). Visual comfort depends on the nature
39 and level of lighting - both daylight and artificial light. Daylight influences our biological
40 clock. It is set for millions of years based on the sun's movement (sunrise and sunset).
41 It controls our physiology and productivity (Aries, 2005; Giarma, Tsikaloudaki and
42 Aravantinos, 2017). Daylight is advised to be the best source of light with excellent
43 colour for human health and comfort. It positively influences occupant mood,
44 performance, and mental attitude (Li and Lam, 2001; Beute and de Kort, 2018). As
45 office employees spend most of their time indoors (Bernstein *et al.*, 2008), office
46 environments depend much on artificial lighting due to numerous circumstances like
47 building design, orientation, and sunlight availability due to clouds or windows. Due to
48 this dependency on artificial light, buildings worldwide use about 40% of the world's
49 annual usage of electricity (Omer, 2008). In the U.K., research suggests that lighting
50 has the most significant share (33%) in total average utilisation of electricity (CIBSE,
51
52
53
54
55
56
57
58
59
60

2015)(See Figure). In the U.S. (2002 data), around US\$40 billion per year is spent on electricity for lighting. About one-third of this expenditure is spent on lighting consumption by American workers, taking US\$5.3 trillion in salaries and producing goods and services worth US\$9.2 trillion (Steffy, 2002). Indoor lighting has a one-third share in global office electricity consumption. These facts make it one of the significant contributors to global carbon emissions.

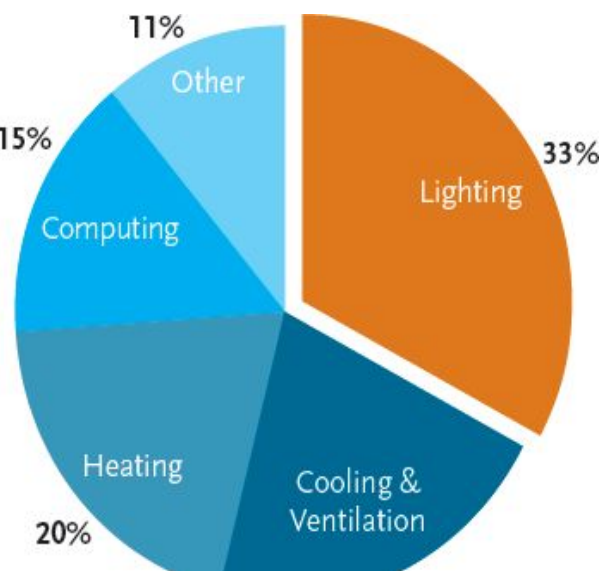


Figure 2 - Electricity usage (U.K.) (CIBSE, 2015)

Research suggests that companies gain long-term profit by higher occupant productivity and lower electricity cost by investing in daylight inclusivity in the workplace design (Lim *et al.*, 2012; Turan *et al.*, 2020; Carletti *et al.*, 2017). Daylight inclusion in workplace design has led to increased attendance and a decrease in occupant complaints in offices (Romm and Browning, 1994; Knoop *et al.*, 2020). Humans prefer natural light when red to artificial light (Elzeyadi, 2011; Kong *et al.*, 2018). Preference can be divided into three categories: psychological, physiological, and physical. Artificial lighting covers a wide range of the colour spectrum that includes the range of sunlight and daylight. The main reasons are psychological and physiological factors. Human performance is highly dependent on parameters such as luminance contrast, retinal illumination, retinal image quality and visual size (de Vries *et al.*, 2018). The visual and circadian system is influenced by natural light (Rea, M. S., Figueiro and Bullough, 2002). It also affects the melatonin hormone, which regulates the body's clock that maintains the body's sleep and alertness pattern in contributes to maintaining alertness and focus during office hours (Nagy, Yasunaga

1
2
3 and Kose, 1995). Both daylight and natural light refer to the light provided by direct or
4 indirect presence due to sunlight.
5
6

7
8 There are many ways to incorporate daylighting into workplace design. One of the
9 widely used is to include windows to maximise daylight in the workspace. Occupants
10 also prefer workplaces with windows and report that they help improve the office tasks'
11 productivity (Cuttle, 1983; Lottrup *et al.*, 2015). Outside views of surrounding green
12 areas and nature also lead to a positive impact on occupant productivity (Cuttle, 1983;
13 Lottrup *et al.*, 2015; Bright, 2012; Grinde and Patil, 2009; Kent and Schiavon, 2020).
14 There is evidence of occupants' preference for natural light and windows. However,
15 various factors need to be accounted for while designing windows for the workplace.
16 Excessive daylight or other light causes 'glare'. It leads to strain in the eye and
17 temporarily reduces the subject's visual capability (human) experiencing it (Słomiński
18 and Krupiński, 2018). These factors include outdoor lighting levels, required indoor
19 lighting levels, outside sky illuminance and the position of the sun (Ne'Eman and
20 Hopkinson, 1970; Mansfield, 2018). Occupant surveys also indicate that universally,
21 they prefer access to sunlight; the windows' desired size and locations may vary
22 depending on the light requirement, size, layout, and position of the desk (Butler and
23 Biner, 1989; Wotton, 1982). In high-rise buildings, providing large windows on the
24 south side (low sun path) leads to higher usage of blinds than on the north side of the
25 building (Rubin, Collins and Tibbott, 1978). In summary, occupants prefer daylight at
26 the workplace; however, window size and location should be determined based on
27 various factors like lighting requirement of the space, layout and orientation of the
28 building, location, and daylight availability.
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43

44
45 Daylighting design is a method to incorporate daylight into the lighting design of a
46 space. It looked at the daylight availability and required light levels using different
47 elements, such as a window, skylight, and reflector glasses (Guzowski, 2000;
48 Manning, 2006; Kittler *et al.*, 1992; Caicedo and Pandharipande, 2016). Illuminance
49 from natural sources is calculated by the Daylight Factor (D.F.). It represents the
50 percentage of daylight in the overall lighting of the space (measured at overcast
51 conditions), which is based on three factors: Sky Component (S.C.), External
52 Reflected Component (ERC) and Internal Reflected Component (I.R.C.) (Wong *et al.*,
53 2017; Hopkinson, Petherbridge and Longmore, 1966; Fontoynt, 2014). The
54 literature recommends 1.5-2.5% D.F. for regular tasks like filling work, general reading,
55
56
57
58
59
60

1
2
3 and meetings. Tasks that require reading, writing, and machine work for long hours
4 need 2.5% - 4% D.F. Mentally straining, challenging tasks that require high focus and
5 attention to detail, such as draughting, fine hand or machine work, writing reports, and
6 document inspection needs 4% - 8% D.F. (Stein, Reynolds and McGuinness, 1992;
7 Reinhart, Mardaljevic and Rogers, 2006). These percentages represent the preferred
8 factor of daylight in the overall illuminance (Lux) of the space. Designers need to be
9 mindful while designing the general illuminance of the space. A higher level of
10 illuminance levels leads to glare that results in visual discomfort.

11
12 Similarly, lower illuminance levels also lead to melatonin hormone secretion that
13 affects alertness, performance, and visual discomfort. Illuminance is the total light's
14 incidence on a surface, measured as Lux (lx) (David L. DiLaura *et al.*, 2011; Hamedani
15 *et al.*, 2019). Visual discomfort leads to lower productivity and wellbeing (Van Den
16 Wymelenberg and Inanici, 2014). Maintaining conducive illuminance levels for a
17 healthy and productive workspace is necessary. Different types of tasks require
18 different illuminance levels. For regular office work such as file work, general reading
19 and meetings, the minimum required is 100 Lux, while the recommended average is
20 200 Lux. For office work that requires detailed work such as report writing and reading,
21 200 - 300 Lux range is recommended. For detailed work for a long time, such as
22 draughting, delicate hand or machine work, the recommended range is 200-500 Lux
23 (Rea, Mark Stanley, 2000).

24
25 Based on the above literature review, we can conclude that the lighting design of a
26 workplace should use indoor (artificial) lighting and daylight to create a conducive
27 lighting environment for the occupants. It should look at contextual factors such as:

- 28 1. Light requirements based on tasks and working hours
- 29 2. Location, orientation, and height of the workplace
- 30 3. Occupant requirement and preference
- 31 4. Availability of daylight

32
33 Along with the above factors, designers should aim to reduce the lighting energy
34 consumption by using various daylighting strategies (Chang and Mahdavi, 2002;
35 Doulos, Tsangrassoulis and Topalis, 2005). Managing light systems by using different
36 light sensors and relays can help to reduce electricity consumption. This system can
37 be used in two ways:

- Maximising daylight usage: A building's electricity usage can be reduced using operational façade elements to utilise daylight in the building efficiently. It involves using sensors to automatically open and close the façade elements by measuring and sensing the outdoor illuminance concerning required indoor illuminance.
- Reducing artificial light usage: Building's electricity usage can be reduced using various movement/occupancy sensors to switch off when occupants leave the building.

The literature review of lighting and daylighting has outlined the fundamentals of lighting, its importance in improving occupant productivity and ideal range based on industry standards. It also outlined various ways to incorporate daylighting into the lighting design of a workspace.

The lighting of a workplace should be designed using several factors. These include lighting, colour and contrast levels that are comfortable for the human eye. Lighting design should also consider the specific lux level requirements for different types of tasks. A combination of lighting systems should be designed that uses both artificial and daylighting to create a sustainable and efficient approach that provides a conducive lighting environment to improve occupant comfort and productivity.

This research focuses on measuring illuminance levels (Lux), daylight access and their influence on occupant comfort and productivity (Table - 1).

Lighting and Daylighting		
Measurable parameters	Instrument	Occupant Survey
Illuminance level (Ambient)	Lighting Sensor	Occupants' response to indoor lighting
Daylight access	Location of the occupant <ul style="list-style-type: none"> • Exterior wall • Interior wall • Exterior window • Interior window 	

Table - 1 - Lighting and Daylighting - Parameters and Instrument

4 Experiment Design

The primary drivers of designing the indoor environment should be based on its contextual climate conditions, the building's layout and orientation, and material and occupant behaviour. Field studies reviewed recommend that Post Occupancy Evaluation (P.O.E.) is an effective way to measure the effect of indoor environmental quality factors on occupant comfort and productivity (Göçer, Hua and Göçer, 2015; Collinge *et al.*, 2014; Hua, Oswald and Yang, 2011; Hirning *et al.*, 2013; Gou and Lau, 2013). This research study used P.O.E. to collect occupants' responses and deployed sensors for physical measurement of Temperature and relative humidity. The experiment was conducted in an office located in the Middle East. The context has a subtropical desert climate. It faces an arid, hot, and humid summer with low annual rainfall. Local weather forces habitants to most of their time indoors. It has also led to the development of enveloped buildings to control the indoor environment and provide comfort and wellbeing to the occupants. It acts as an opportunity to investigate this topic in given climatic conditions. People spending most time indoors in a controlled indoor environment meant that the office serves as the most effective working laboratory for the experiment. A medium-sized office with 40 employees was used for the investigation. It was divided into 12 zones, and sensors were installed accordingly (Figure - 2). The data was analysed using Response Surface Methodology in MiniTab. The regression equation's outcomes determine the mathematical relationship between independent (indoor parameters) and dependent (occupant productivity) variables. It also produced an R-square value that determines the degree of association between independent and dependent variables and contour and surface plots that present the multinomial relationship between occupant productivity and various indoor environmental parameters.

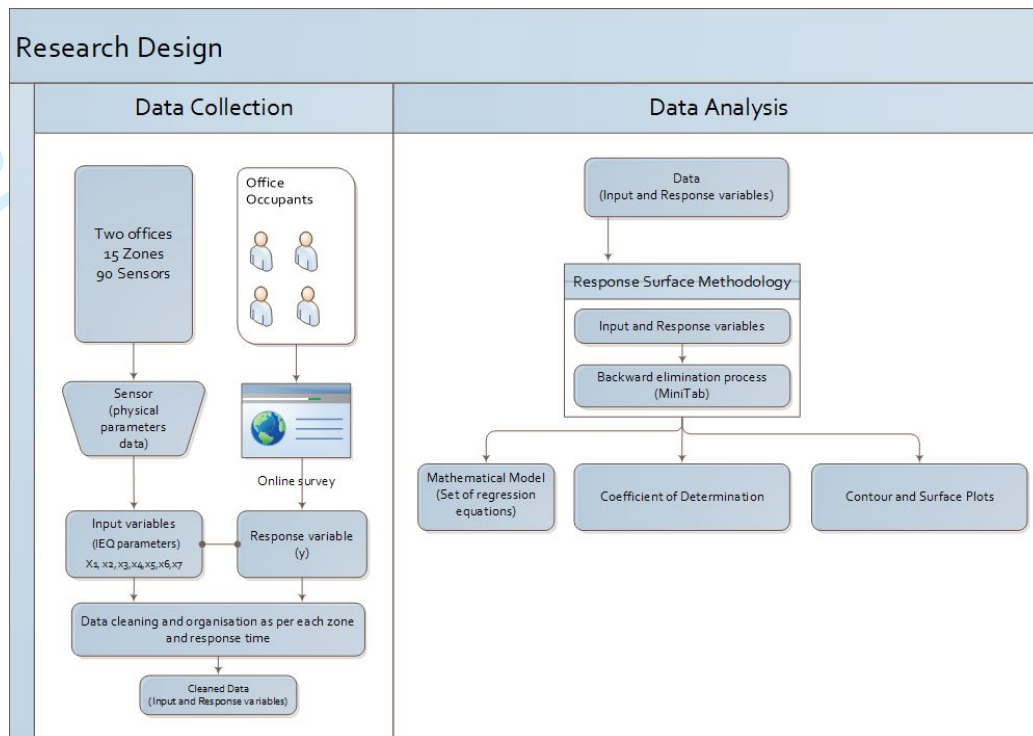


Figure - 3 - Research Design

4.1 Occupant Survey

The study involved sending an online survey to occupants every fortnight by the organisation's Human Resource department. Data was collected and stored safely, and employee profiles were managed using data encryption and were kept anonymous. The replies were time-stamped along with their zone. The research team created a questionnaire (Table - 2) for occupants to fill online. The study also focused on other indoor environmental quality factors and collected physical data and occupant response. This paper concentrates only on visual comfort and outlines any interactions of different environmental parameters on visual comfort. The study uses an occupant survey on self-reported productivity, and there are certain reservations about such surveys in the literature (Göçer *et al.*, 2019; Lipczynska, Schiavon and Graham, 2018). Due to this, the question was focused on the effects of the indoor environment on productivity rather than employees' productivity levels. This also aligns with the study's aim to outline the effect of the indoor environment on productivity rather than the measure of productivity. The survey asked occupants to respond to illumination levels and how it was affecting their productivity. The response options were very negative, negative, neutral, positive, and very positive, based on the Likert scale (Allen and Seaman, 2007). Each response was time-stamped along with the zone to ensure

that every measurement was accurately calculated (average of a past hour). Each response was mapped against the physical parameters measured, such as temperature, relative humidity, lux levels, carbon dioxide, and sound. Survey response was time-stamped. Hence, they can be correlated with the sensor data for each data point. In the response surface methodology term, these data points can also be termed as *runs*. The runs would enable us to calculate and generate several relationship equations between seven input variables and the performance variable(y).

Question - How have these factors affected your productivity?

	Indoor environment factor	Very Negatively	Negatively	Neutral	Positively	Very Positively
A	Thermal comfort					
B	Natural ventilation					
C	Mechanical ventilation					
D	Low emitting materials					
E	Illumination levels					
F	Daylight					
G	Indoor chemical & pollutant source control					
H	Acoustic quality					
I	Office layout					

Table 2 - Survey Questions

4.2 Physical Parameters Measurement

The physical environment data were collected using sensors in each zone. The experiment used factory calibrated sensors for all the environmental parameters. Literature also outlined that outdoor Temperature and relative humidity indirectly impact occupant comfort and productivity inside mechanically ventilated buildings (Humphreys, 2005; Humphreys and Nicol, 2000). Hence, outdoor temperature and relative humidity sensors were also installed to map any outdoor thermal environment's effect on occupant comfort and productivity. All the sensors were connected to a base unit (B.R.E. base unit) which uploaded the data to an online repository that allowed downloading the data in the excel file. All the sensors were

monitored to ensure that they were working efficiently. Office Layout data was collected from the seating position of the employees. There were five types of workspaces: individual room, shared cubicle, cubicle and open plan, and shared open plan. There were three options for window type: exterior window, interior window, and no window. This data was collected from the Human Resource Department and layout plan. Participants' names were removed, and identities were kept anonymous.

I.E.Q. factor	Parameter	Measured by	Input Variable	Response/ performance variable
Thermal comfort	Temperature	Zigbee T-3524C	x_1	y (calculated from the survey responses)
	Relative humidity		x_2	
	Outside Temperature	Vantage Pro	x_3	
	Outside R.H.		x_4	
Indoor Air Quality	Carbon dioxide	Zigbee T-3571	x_5	
	Volatile Organic Compound	Zigbee T-3576	x_6	
Lighting	Lux level		x_7	
Noise	Sound level	Zigbee T-3551	x_8	
Office Layout	Seating Arrangement	Researcher (Office plan)	x_9	

Table 3 - I.E.Q. Parameters Measurement

4.3 Data Analysis: Response Surface Methodology

This research study used the Response Surface Methodology (R.S.M.) for data analysis. It provides a framework for analysing Indoor Environmental Quality. Parameter data and occupant survey data to develop various statistical relationship models that outline the degree of influence of each I.E.Q. Factor on occupant productivity. R.S.M. is a collection of statistical and mathematical techniques used to develop and interpret polynomial equations (Box and Draper, 1987; Myers, Montgomery and Anderson-Cook, 2016). The main aim of the R.S.M. model is to

investigate independent variables, test empirical models for developing an appropriate relationship between the response and the input variables and optimise methods for estimating values of x_1, x_2, \dots, x_k that produce the most desirable value of y (Ximénez and San Martín, 2000; Hill and Hunter, 1966; Alizadeh and Sadrameli, 2019).

$$f = y = f(x_1, x_2, \dots, x_k) + \varepsilon$$

$y =$ response/ performance variable

$x =$ input variables

$\varepsilon =$ noise or error observed in the response y

The surface represented by $f(x_2, \dots, x_k)$ is called the response surface. It can be represented graphically (three-dimensional space or as contour plots) to understand the shape of the response surface. This analysis used R.S.M. to generate the relationship between nine parameters (under five indoor environmental factors) and occupant response (Survey).

The data was collected for twelve months and resulted in 500 survey data points. After the cleaning and adjustment, 368 data points were used to perform the analysis. The response surface analysis was conducted using Minitab software. The researcher used a backward elimination procedure to conduct response surface analysis. This process helps eliminate any input variable with a profound effect on the output variable in any multiple regression analysis. Backward elimination starts with all the input variables in the model and eliminates one input variable in each run with the least effect on the model. This stepwise procedure continues until the no input variables in the model have a p-value greater than the value specified (alpha to remove). In this case, researchers used 0.1 as alpha to remove the value in this experiment. It produces results with 90% confidence.

5 Results: Response Surface Methodology

Response surface analysis of visual comfort was carried out to identify the input variables that influence an occupant's perception of visual comfort and how it affects their productivity. This section is divided into three sections: ANOVA (Analysis of Variance), R square (Coefficient of Determination), Regression Equation, Response Surface Analysis.

5.1 Analysis of Variance (ANOVA)

Analysis of Variance test is used to describe the relationship between independent and dependent variables (Tabachnick and Fidell, 2007; Kirk, 2012).

The experiment was based on the following hypothesis:

- H_0 = Variable does not affect occupant's visual comfort and its impact on productivity.
- H_{alt} = Variable influences occupant's visual comfort and its impact on productivity.

The ANOVA is done using $\alpha=0.1$.

If p-value ≥ 0.1 , it indicates strong evidence of null hypothesis.

If p-value ≤ 0.1 , it indicates strong evidence against the null hypothesis, hence rejecting the null hypothesis.

Based on the ANOVA, the following factors influence occupant visual comfort level and its impact on the productivity of occupants:

1. Illumination (Light)
2. Temperature
3. Relative Humidity
4. Sound
5. Kind of workspace

The above factors affect visual comfort both directly and indirectly. All these factors have a different magnitude of influence.

5.2 Regression Analysis

Regression analysis was also conducted as part of the response surface analysis. The coefficient of determination (adjusted R-square) value is 82.25%. It indicates that the functional equation explains 82% of variations in the dependent variable, leaving only 18% of variations unexplained. It also produced a regression equation (corrected up to three decimal places).

$$\begin{aligned}
 \text{Visual Comfort and Productivity} = & -0.42 + 0.01 (\text{Light}) - 0.007(\text{Relative Humidity}) + 0.01(\text{Sound}) \\
 & + 0.150 (\text{Kind of Workspace}_1) + 0.376 (\text{Kind of Workspace}_2) - \\
 & 0.66 (\text{Kind of Workspace}_3) - 0.185 (\text{Kind of Workspace}_4) \\
 & + 0.32 (\text{Kind of Workspace}_5) - 1.22 (\text{Do you sit near (wall type):}_1) \\
 & - 0.02 (\text{Do you sit near (wall type):}_2) \\
 & + 1.183 (\text{Do you sit near (wall type):}_3)
 \end{aligned}$$

Variables

- Light = Lux level
- Relative Humidity of the space
- Sound = dBA level
- Kind of workspace_1 = Individual room
- Kind of workspace_2 = Shared room (up to two occupants)
- Kind of workspace_3 = Cubicle
- Kind of workspace_4 = Open plan
- Kind of workspace_5 = Shared open-plan space
- Do you sit near (wall type) _1 = Exterior wall
- Do you sit near (wall type) _2 = Interior wall
- Do you sit near (wall type) _3 = Exterior window
- Do you sit near (wall type) _4 = Interior window

The regression equation shows by how much each of the specified independent variable influence or affect the dependent variable, which in this case is the occupant's visual comfort and productivity. The equation provides some expected outcomes and some new implicit effects.

- Lux and Sound level - It demonstrates that lux and sound level has a subtle effect on visual comfort and productivity (0.01). It shows that an increase in lux level leads to improvement in visual comfort and productivity.
- Kind of workspace – It demonstrates that individual (+.150) and shared (up to two occupants) rooms (+0.376) have a positive impact on visual comfort and productivity. Open plan (low-level partition) (-0.185) and cubicle (-0.66) have a negative impact, and interestingly, shared open-plan (open plan without low-level partition) (+0.32) has a positive impact on productivity.
- Wall type – It demonstrates that no access to a window (wall type 1,2) has a negative impact on visual comfort and exterior window access has a significant impact on visual comfort and productivity. Window and natural light access and its relation to productivity are widely documented in the literature, and this study confirms the literature. It will also help to predict the variation in visual comfort and productivity.

The equation analysis shows that access to natural light has a more substantial effect than overall lux levels. Individual and shared rooms are preferred over the cubicle and low height open plan.

5.3 Response Surface Analysis

Response Surface Analysis produced contour and surface plots. They are used to identify optimal results by showing the effect of two independent variables on the dependent variable. This section only highlights the plots that show substantial impacts or results on visual comfort and its effect on productivity.

5.3.1 Effect of Temperature, Carbon Dioxide on Visual Comfort and Productivity

Temperature and carbon dioxide influence visual comfort and their impact on productivity (Bueno, et. al., 2021). The temperature range between 20 - 27°C has a very positive influence on visual comfort. The carbon dioxide range has a very positive effect when 550 ppm and below. The plotlines in Figure 4 show that temperature has more influence on visual comfort than carbon dioxide. Carbon Dioxide has minimal impact, and the temperature has an indirect effect on visual comfort and productivity.

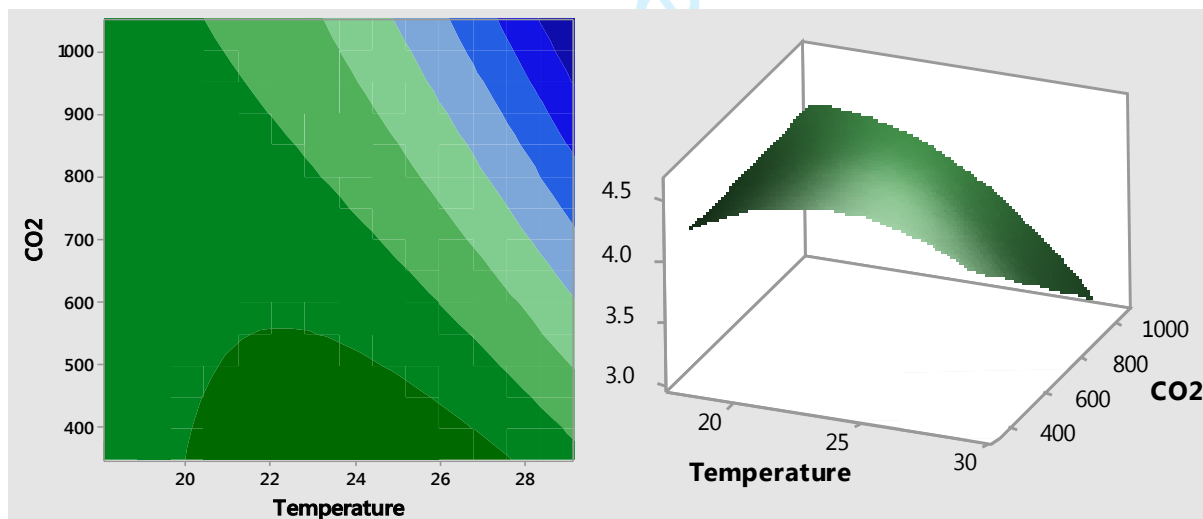


Figure 4 - Effect of Temperature, Carbon Dioxide on Visual Comfort

5.3.2 Effect of V.O.C., Light on Visual Comfort and Productivity

Contour and surface plots in figure – 5 show that V.O.C. does not show any effect on visual comfort. Light levels have a significant impact on visual comfort. It confirms the ANOVA test findings that V.O.C. doesn't have any influence on visual comfort. The

plot indicates that the lighting level has a significant impact on visual comfort. The optimum lighting levels are 350 - 450 Lux.

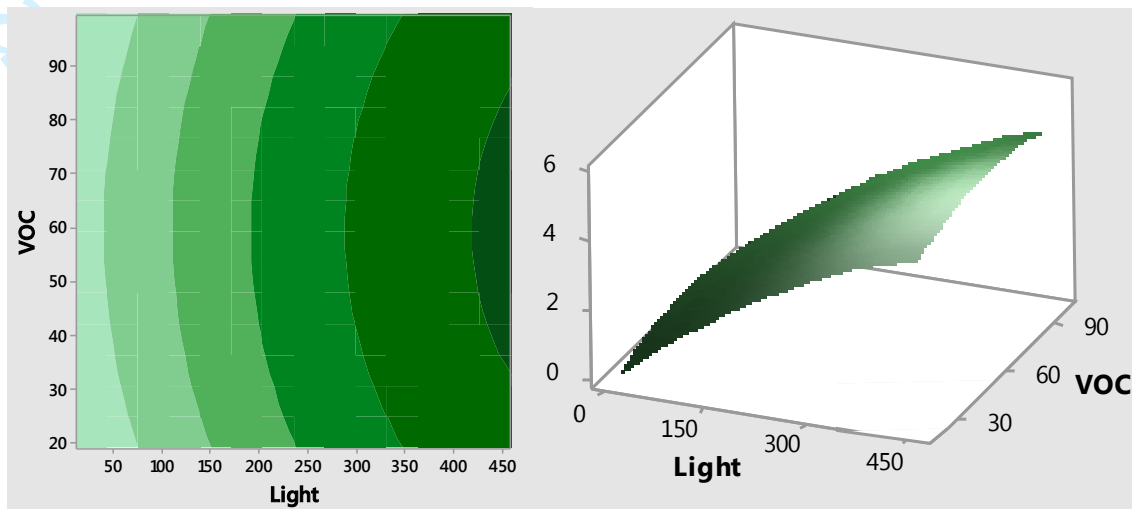


Figure 5 - Effect of V.O.C., Illumination on Visual Comfort

5.3.3 Effect of Sound, Light on Visual Comfort and Productivity

The plotlines in Figure 6 indicate that sound does not have a significant effect on visual comfort. ANOVA test shows that sound affects visual comfort and productivity. However, this relationship shows that sound does not affect visual comfort compared to illumination (light intensity). Illumination has a direct impact on visual comfort, and the optimum range is 325 - 450 Lux.

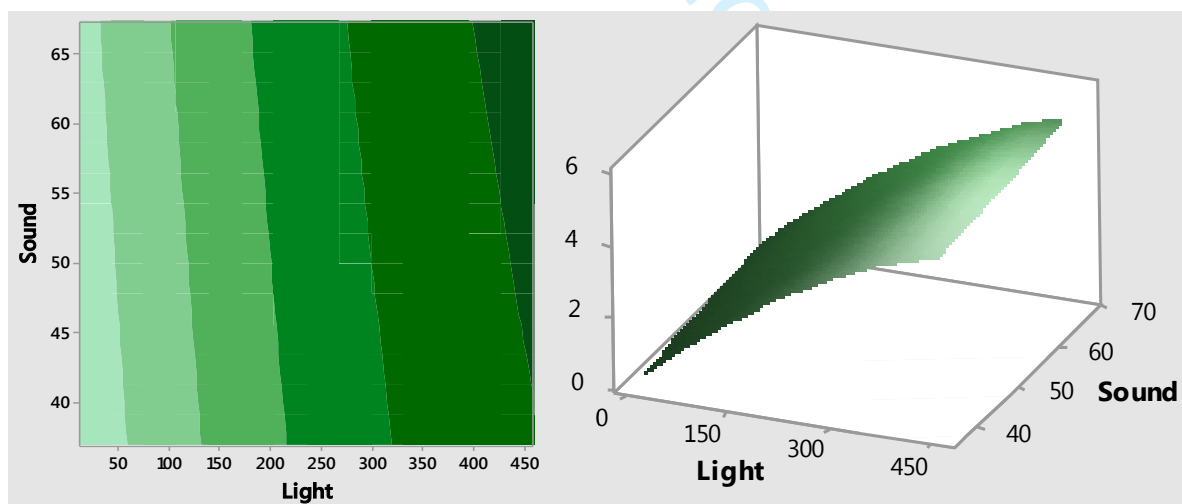


Figure 6 - Effect of Sound, Illumination on Visual Comfort

5.3.4 Effect of Outside Relative Humidity, Illumination (Light) on Visual Comfort and Productivity

Contour and surface plots in Figure 7 indicate that outside relative humidity does not significantly affect visual comfort. It confirms the finding of ANOVA results on outside relative humidity. Illumination levels directly affect visual comfort, and the optimum range is 275 - 450 Lux. It has a positive effect from 200 Lux, and it has a very positive impact from 275 Lux.

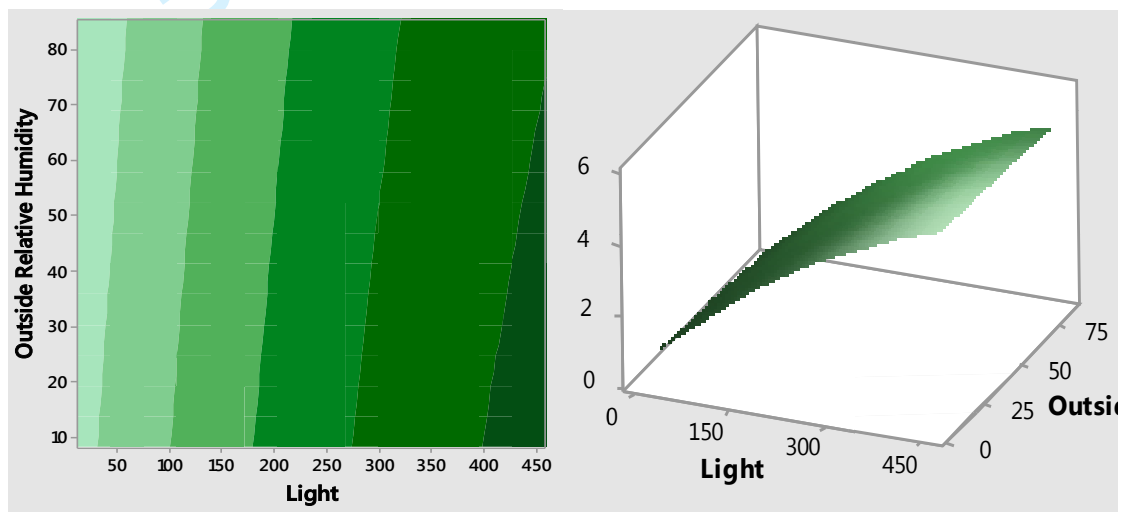


Figure 7 - Effect of Outside R.H., Illumination on Visual Comfort

5.3.5 Effect of Outside Temperature, Illumination (light) on Visual Comfort and Productivity

Contour and surface plots in Figure 8 show that outside temperature does not significantly affect visual comfort. It confirms the ANOVA test result that outside temperature has no direct impact on indoor visual comfort. Illumination levels directly affect visual comfort, and the optimum range is 350 - 450 Lux.

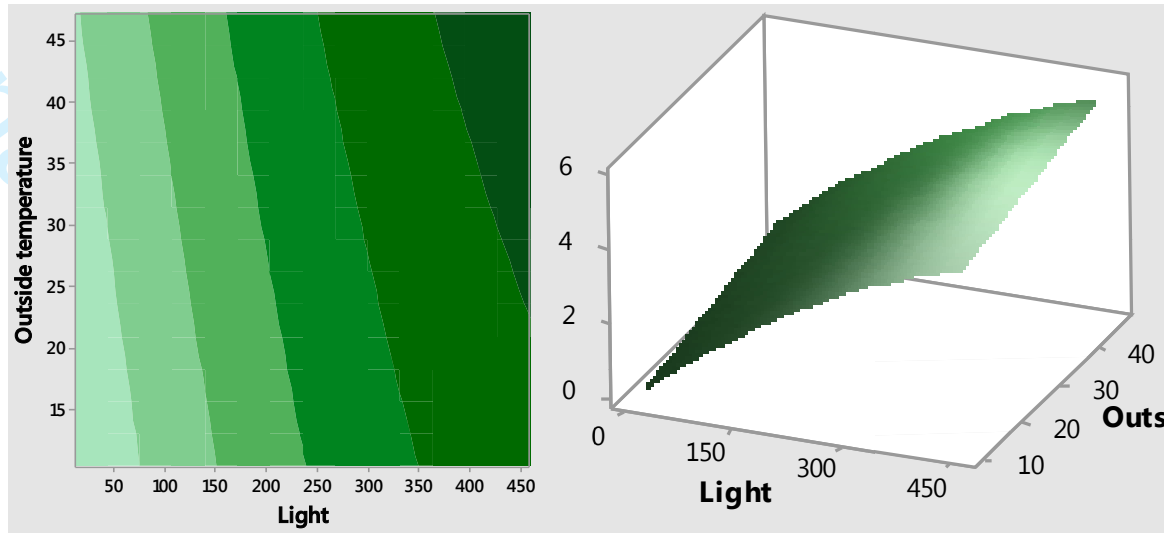


Figure 8 – Effect of Outside Temperature, Illumination on Visual Comfort

5.3.6 Effect of Relative Humidity, Illumination (Light) on Visual Comfort and Productivity

The plots in Figure 9 show that relative humidity does not have a significant effect on visual comfort. However, ANOVA results show that relative humidity does affect visual comfort. It demonstrates that relative humidity has an indirect influence and no substantial impact compared to illumination (light intensity) on visual comfort. Illumination has a direct effect on visual comfort, and the optimum range is 325 - 450 Lux.

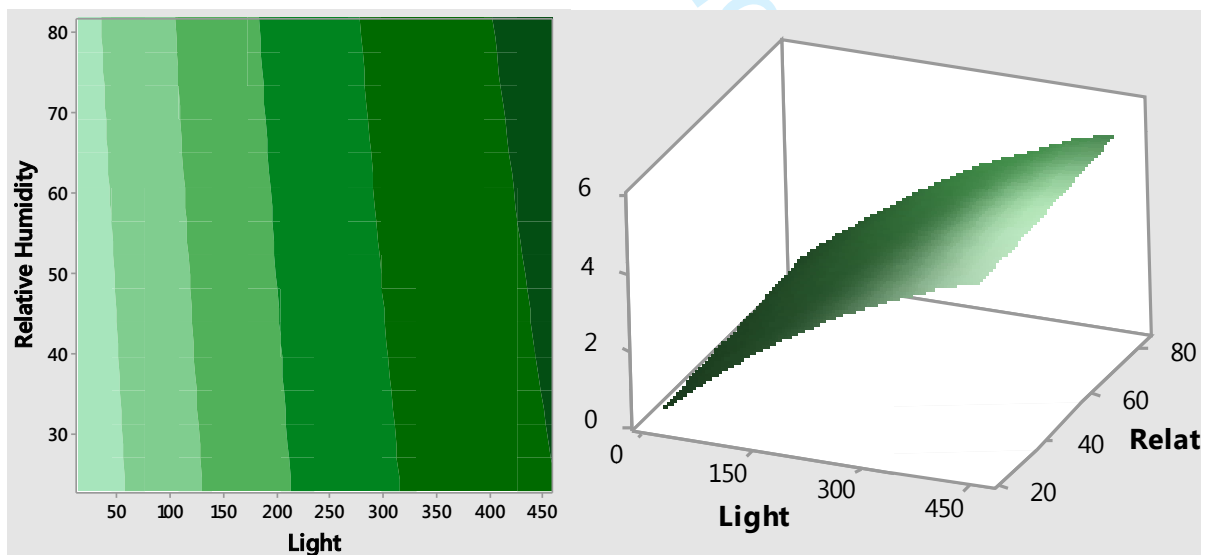


Figure 9 - Effect of Relative Humidity, Light on Visual Comfort

5.3.7 Effect of Temperature, Illumination (Light) on Visual Comfort and Productivity

The contour and surface plots in figure 10 show that temperature does not significantly affect visual comfort compared to illumination. ANOVA test and relationship indicate that temperature does influence visual comfort. Illumination level directly affects visual comfort, and the optimum range is 325 - 450 Lux.

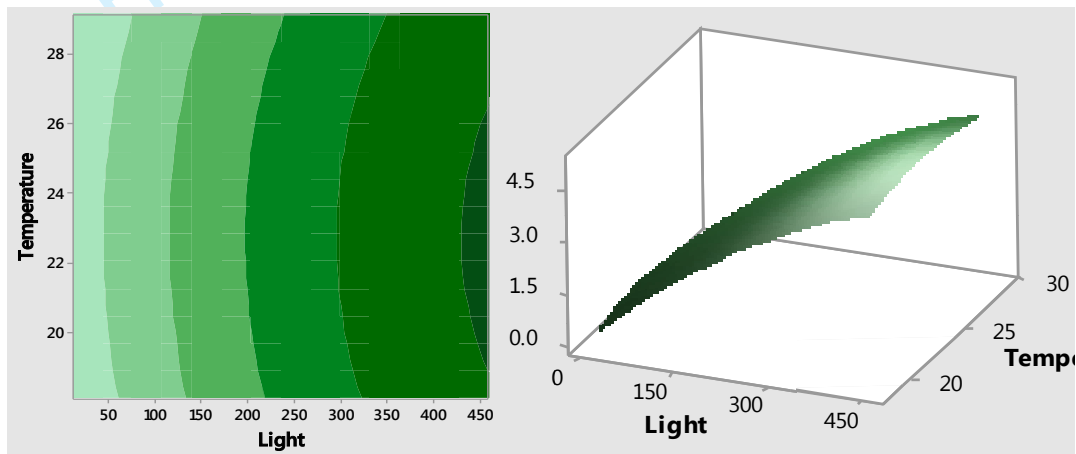


Figure 10 – Effect of Relative Humidity, Illumination (Light) on Visual Comfort

6 Discussion

This study aimed to outline the influence of various physical environmental parameters on occupants' visual comfort and productivity. Response surface analysis produced regression equation can determine occupant visual comfort in a similar geographic and climatic context. It also produced unique relationships between independent variables (indoor environmental quality parameters) and dependent variables (visual comfort and productivity). Table 4 indicates seven relationships were produced and examined from the response surface analysis.

S.no.	Independent Variable 1	Effect & Range	Independent Variable 2	Effect & Range
1	Temperature	20 - 27°C	Carbon Dioxide	Up to 550 ppm
2	V.O.C.	No effect	Illumination	350 – 540 lux
3	Sound	No effect	Illumination	225 above positive

				325 above very positive
4	Outside Relative Humidity	No effect	Illumination	275 – 450 lux
5	Outside Temperature	No effect	Illumination	350 – 450 lux
6	Relative Humidity	No effect	Illumination	325 – 450 lux
7	Temperature	No effect	Illumination	325 – 450 lux

Table 4 – Seven relationships between indoor environment quality factor and occupant productivity

The following sections discuss key findings of the indoor environmental parameters and their role in visual comfort and productivity and effect on building design and operations:

6.1 Illumination

Illumination has the maximum impact on occupant comfort and productivity. Results indicate that, comparatively, illumination has the most substantial influence over visual comfort and productivity than Temperature, V.O.C., Sound, Outside Relative Humidity, Outside Temperature, Relative Humidity and Temperature. Results indicate that illumination has a 'positive' effect from 225 lux and a 'very positive' impact from 325 till 450 lux. These results presented are focused on desktop work in an indoor environment. These findings confirm the current literature on illumination's effect on occupant visual comfort and productivity (Van Den Wymelenberg and Inanici, 2014; Lai *et al.*, 2009; Han and Tai Kim, 2010). Beyond the literature confirmation, the study presents a new recommended lux range focusing on the productivity and mathematical relationship between illumination and productivity. The implications are that design professionals should concentrate on developing lighting design strategies that aim to establish ambient and task illumination levels.

Furthermore, this study outlined the recommended range for office tasks. It is also recommended to use both natural and artificial light to achieve the required illumination level, manage carbon footprint, and improve occupants' productivity. Literature has also highlighted that natural light is the preferred source of light for occupant wellbeing

1
2
3 and productivity (Li and Tsang, 2008; Galasiu and Veitch, 2006; Shindler, 2019).
4 Design automation with active façade elements is actively used along with passive
5 design strategies to manage the daylight consumption in a well-lit building that
6 promotes occupant visual comfort and productivity. Asset managers should manage
7 the building's operational process to harvest maximum daylight by organising activities
8 and spaces based on their illumination requirements.
9
10
11
12

13 14 **6.2 Temperature**

15
16 Results indicate that indoor temperature ranks second in the indoor environmental
17 quality factor. The relationship shows that indoor temperature has a 'very positive'
18 effect at 20 - 27°C and a neutral effect between 19 – 20°C. The finding of an indirect
19 effect of temperature on occupant visual comfort is a new contribution to the literature
20 on indoor environmental quality and occupant productivity. However, the
21 recommended range for visual comfort is the same as that for thermal comfort
22 (Kaushik *et al.*, 2020). It shows that thermal comfort has an indirect effect on visual
23 comfort. Therefore, there shouldn't be significant design implications of this result for
24 building design.
25
26
27
28
29
30
31
32

33 Nonetheless, building design professionals should follow thermal comfort guidelines.
34 Design and operation professionals should focus on maintaining the recommended
35 range using H.V.A.C. (Heating Ventilation and Air conditioning) system in
36 mechanically ventilated buildings. In mix-mode buildings and natural ventilation, the
37 focus should be more diverse, including passive design techniques such as building
38 orientation, sun path, opening sizes and location, and plants and shrubs to manage
39 the indoor thermal environment. It could be considered in the design and operation
40 strategies and lighting design in the building's design phase. Lighting and the thermal
41 environment influence each other, and both should be considered during the design
42 phase using design and building simulation techniques.
43
44
45
46
47
48
49
50

51 **6.3 Relative Humidity**

52 ANOVA indicated that relative humidity influences occupant visual comfort and
53 productivity. However, when compared to illumination, it showed minimal influence. It
54 demonstrates that relative humidity has an indirect effect on visual comfort. It is a
55 thermal comfort parameter, and as earlier indicated, the thermal environment has an
56
57
58
59
60

1
2
3 indirect influence on occupant's visual comfort and productivity. Hence, relative
4 humidity should be managed as per thermal comfort guidelines and should be kept in
5 the comfort range to maintain thermal comfort.
6
7

8 9 **6.4 Sound**

10
11 ANOVA indicated that sound influences occupant visual comfort and productivity.
12 However, compared to illumination, it showed no effect, indicating that sound doesn't
13 have a more substantial impact than illuminance.
14
15
16

17 18 **6.5 Office Layout (Kind of Workspace, Wall Type)**

19
20 ANOVA indicated that both, kind of workspace and seat location near-wall type
21 influences occupant comfort. This finding confirms that access to daylight positively
22 influences visual comfort (Boyce, Peter, Hunter and Howlett, 2003; Li, 2010). It
23 reinforces the importance of office layout, building orientation and façade design in the
24 building design process (Lim *et al.*, 2012; Yang and Nam, 2010; Yildirim, Akalin-
25 Baskaya and Celebi, 2007; Mansfield, 2018).
26
27
28
29

30 31 **7 Conclusion**

32
33 This research study was conducted to outline the effect of the indoor environment on
34 visual comfort and occupant productivity in office buildings. It used response surface
35 methodology to present regression analysis and equation that represents the
36 relationship between indoor environmental quality and occupant visual comfort and
37 productivity. Results include seven relationships presented to show the effect of
38 different indoor environmental quality parameters, their recommended range, and
39 inferences. Findings indicate that occupants prefer illumination levels between 300
40 and 450 lux for the indoor working environment and shown preference towards
41 daylight. This study recommends using passive and active design techniques to
42 harvest natural light while managing the artificial light focus to maintain required lux
43 levels. Apart from illumination levels, temperature, relative humidity, and access to
44 daylight also influence visual comfort and productivity. These unique relationships also
45 presented inter-relationships and dependencies. Based on this study, it is
46 recommended that design guidelines and policies for office buildings should
47 incorporate visual comfort and productivity in design criteria. These recommendations
48
49
50
51
52
53
54
55
56
57
58
59
60

1
2
3 are only suggested for the Middle East region since the study was conducted in the
4 Middle East.
5
6

7 These results have direct significance for building design. Construction professionals
8 are to ensure that the design and specifications meet the recommended range of
9 indoor environmental quality parameters during the building's operation phase. While
10 this may lead to the higher energy usage of the building, annual operational efficiency
11 gained from more productive and healthier occupants would lead to lower overall
12 energy usage and production efficiency leading to lower costs. However, there is a
13 need for future research on operational cost versus occupant productivity gain that
14 can be sustained in the long run. The need for lighting design to be an essential part
15 of the design process cannot be overemphasised enough. As a result, both daylight
16 and artificial light should be used to achieve recommended levels of visual comfort in
17 buildings. As this study has shown, utilising daylight can help to reduce the costs of
18 enhancing the visual environment.
19
20
21
22
23
24
25
26
27
28

29 Furthermore, future research could also perform a comparative study of other building
30 types other than office buildings and under different climatic conditions to see the
31 nature of statistical relationships that may exist between occupant comfort,
32 productivity, and indoor environmental quality parameters. Similarly, an A.I. Building
33 Management system with an active façade system to harness maximum daylight by
34 using sensors can be developed. This system will allow yearly data of sun and weather
35 movements, along with lighting usage in the building. It can be further used to predict
36 patterns of both daylight availability and usage of the buildings. It would help to
37 improve the allocation of space in a building to minimise the carbon footprint of the
38 building.
39
40
41
42
43
44
45
46
47

48 **8 References**

49
50
51 Abbaszadeh, S., Zagreus, L., Lehrer, D. and Huizenga, C. (2006) 'Occupant
52 satisfaction with indoor environmental quality in green buildings', *Center for the Built
53 Environment*, .
54

55 Al-Esia, Z. and Skok, W. (2015) 'Arab knowledge sharing in a multicultural workforce:
56 a dual case study in the UAE', *Arabian Journal of Business and Management Review*,
57 2015.
58
59
60

1
2
3 Alizadeh, M. and Sadrameli, S.M. (2019) 'Indoor thermal comfort assessment using
4 PCM based storage system integrated with ceiling fan ventilation: Experimental design
5 and response surface approach', *Energy and Buildings*, 188, pp. 297-313.

6
7
8 Allen, I.E. and Seaman, C.A. (2007) 'Likert scales and data analyses', *Quality
9 Progress*, 40(7), pp. 64.

10
11 Aries, M.B.C. (2005) *Human lighting demands: healthy lighting in an office
12 environment*. Technische Universiteit Eindhoven. Available at: (Accessed: .
13

14
15 ASHRAE (1993) 'ASHRAE Fundamentals - Handbook', *Atlanta*, .

16
17 Bernstein, J.A., Alexis, N., Bacchus, H., Bernstein, I.L., Fritz, P., Horner, E., Li, N.,
18 Mason, S., Nel, A., Oullette, J., Reijula, K., Reponen, T., Seltzer, J., Smith, A. and
19 Tarlo, S.M. (2008) 'The health effects of nonindustrial indoor air pollution', *Journal of
20 Allergy and Clinical Immunology*, 121(3), pp. 585-591. doi:
21 <https://doi.org/10.1016/j.jaci.2007.10.045>.

22
23
24 Beute, F. and de Kort, Y.,A.W. (2018) 'The natural context of wellbeing: Ecological
25 momentary assessment of the influence of nature and daylight on affect and stress for
26 individuals with depression levels varying from none to clinical', *Health & place*, 49,
27 pp. 7-18.

28
29
30 Bluysen, P.M., De Oliveira Fernandes, E., Groes, L., Clausen, G., Fanger, P.O.,
31 Valbjørn, O., Bernhard, C.A. and Roulet, C.A. (1996) 'European Indoor Air Quality
32 Audit Project in 56 Office Buildings', *Indoor air*, 6(4), pp. 221-238. doi: 10.1111/j.1600-
33 0668.1996.00002.x.

34
35
36 Box, G.E.P. and Draper, N.R. (1987) *Empirical model-building and response surfaces*.
37 Wiley New York.

38
39 Boyce, P.R. (1997) 'Light, sight and photobiology', *Lighting Futures*, 2(3).

40
41 Boyce, P., Hunter, C. and Howlett, O. (2003) 'The benefits of daylight through
42 windows', *Troy, New York: Rensselaer Polytechnic Institute*, .

43
44
45 Bright, G.T. (2012) 'The economics of Biophilia', *Why designing with nature in mind
46 makes financial sense*. New York (NY): Terrapin Bright Green, .

47
48
49 Bueno, A.M., de Paula Xavier, Antonio Augusto and Broday, E.E. (2021) 'Evaluating
50 the Connection between Thermal Comfort and Productivity in Buildings: A Systematic
51 Literature Review', *Buildings*, 11(6), pp. 244.

52
53
54 Butler, D.L. and Biner, P.M. (1989) 'Effects of setting on window preferences and
55 factors associated with those preferences', *Environment and Behavior*, 21(1), pp. 17-
56 31.

57
58
59 Caicedo, D. and Pandharipande, A. (2016) 'Daylight and occupancy adaptive lighting
60 control system: An iterative optimisation approach', *Lighting Research & Technology*,
48(6), pp. 661-675.

1
2
3 Carletti, C., Cellai, G., Pierangioli, L., Scurpi, F. and Secchi, S. (2017) 'The influence
4 of daylighting in buildings with parameters nZEB: application to the case study for an
5 office in Tuscany Mediterranean area', *Energy Procedia*, 140, pp. 339-350.

6
7
8 Chang, S. and Mahdavi, A. (2002) 'A hybrid system for daylight responsive lighting
9 control', *Journal of the Illuminating Engineering Society*, 31(1), pp. 147-157.

10
11 CIBSE (2015) *The CIBSE Journal CPD Programme: Lighting control technologies and*
12 *strategies to cut energy consumption* CIBSE.

13
14
15 Collinge, W.O., Landis, A.E., Jones, A.K., Schaefer, L.A. and Bilec, M.M. (2014)
16 'Productivity metrics in dynamic LCA for whole buildings: Using a post-occupancy
17 evaluation of energy and indoor environmental quality tradeoffs', *Building and*
18 *Environment*, 82, pp. 339-348. doi: 10.1016/j.buildenv.2014.08.032.

19
20
21 Cuttle, C. (1983) *People and windows in workplaces*. pp. 47.

22
23 David L. DiLaura, Houser, K., Mistrick, R. and Gary R. Steffy (2011) *The Lighting*
24 *Handbook: Reference and Application*. Illuminating Engineering Society of North
25 America.

26
27
28 de Vries, A., Souman, J.L., de Ruyter, B., Heynderickx, I. and de Kort, Y.A. (2018)
29 'Lighting up the office: The effect of wall luminance on room appraisal, office workers'
30 performance, and subjective alertness', *Building and Environment*, 142, pp. 534-543.

31
32
33 Djongyang, N., Tchinda, R. and Njomo, D. (2010) 'Thermal comfort: A review paper',
34 *Renewable and Sustainable Energy Reviews*, 14(9), pp. 2626-2640. doi:
35 <http://dx.doi.org/10.1016/j.rser.2010.07.040>.

36
37
38 Doulos, L., Tsangrassoulis, A. and Topalis, F.V. (2005) *A critical review of simulation*
39 *techniques for daylight responsive systems*.

40
41
42 Elzeyadi, I.M.K. (2011) 'Daylighting-Bias and Biophilia: Quantifying the Impact of
43 Daylighting on Occupants Health', *US Green Building*
44 *Council*. [http://www.usgbc.org/sites/default/files/OR10_Daylighting%
45 20Bias%
46 20and% 20Biophilia.pdf](http://www.usgbc.org/sites/default/files/OR10_Daylighting%20Bias%20and%20Biophilia.pdf), .

47
48
49 Fisk, W.J., Spengler, J.D., Samet, J.M. and McCarthy, J.F. (1999) *Indoor Air Quality*
50 *Handbook*.

51
52
53 Fisk, W.J. (2011) 'Potential nationwide improvements in productivity and health from
54 better indoor environments', *Lawrence Berkeley National Laboratory*, .

55
56
57 Fisk, W.J. (2000a) 'Estimates of potential nationwide productivity and health benefits
58 from better indoor environments: an update', *Indoor air quality handbook*, 4.

59
60
61 Fisk, W.J. (2000b) 'Health and productivity gains from better indoor environments and
62 their relationship with building energy efficiency', *Annual Review of Energy and the*
63 *Environment*, 25(1), pp. 537-566.

1
2
3 Fontoynt, M. (2014) *Daylight performance of buildings*. Routledge.

4
5 Frontczak, M. and Wargocki, P. (2011) 'Literature survey on how different factors
6 influence human comfort in indoor environments', *Building and Environment*, 46(4),
7 pp. 922-937.

8
9
10 Galasiu, A.D. and Veitch, J.A. (2006) 'Occupant preferences and satisfaction with the
11 luminous environment and control systems in daylit offices: a literature review', *Energy
12 and Buildings*, 38(7), pp. 728-742.

13
14 Geng, Y., Ji, W., Lin, B. and Zhu, Y. (2017) 'The impact of thermal environment on
15 occupant IEQ perception and productivity', *Building and Environment*, 121, pp. 158-
16 167.

17
18
19 Giarma, C., Tsikaloudaki, K. and Aravantinos, D. (2017) 'Daylighting and visual
20 comfort in buildings' environmental performance assessment tools: a critical review',
21 *Procedia Environmental Sciences*, 38, pp. 522-529.

22
23
24 Göçer, Ö, Candido, C., Thomas, L. and Göçer, K. (2019) 'Differences in occupants'
25 satisfaction and perceived productivity in high-and low-performance offices', *Buildings*,
26 9(9), pp. 199.

27
28
29 Göçer, Ö, Hua, Y. and Göçer, K. (2015) 'Completing the missing link in building design
30 process: Enhancing post-occupancy evaluation method for effective feedback for
31 building performance', *Building and Environment*, 89, pp. 14-27. doi:
32 10.1016/j.buildenv.2015.02.011.

33
34
35 Gou, Z. and Lau, S.S. (2013) 'Post-occupancy evaluation of the thermal environment
36 in a green building', *Facilities*, 31(7), pp. 357-371. doi: 10.1108/02632771311317493.

37
38
39 Gou, Z., Lau, S.S. and Ye, H. (2014) 'Visual alliesthesia: The gap between comfortable
40 and stimulating illuminance settings', *Building and Environment*, 82, pp. 42-49. doi:
41 10.1016/j.buildenv.2014.08.001.

42
43
44 Grinde, B. and Patil, G.G. (2009) 'Biophilia: does visual contact with nature impact on
45 health and wellbeing?', *International Journal of Environmental Research and Public
46 Health*, 6(9), pp. 2332-2343.

47
48
49 Guzowski, M. (2000) *Daylighting for sustainable design*. McGraw-Hill Professional
50 Publishing.

51
52
53 Hailu, H., Gelan, E. and Girma, Y. (2021) 'Indoor Thermal Comfort Analysis: A Case
54 Study of Modern and Traditional Buildings in Hot-Arid Climatic Region of Ethiopia',
55 *Urban Science*, 5(3), pp. 53.

56
57
58 Hamedani, Z., Solgi, E., Skates, H., Hine, T., Fernando, R., Lyons, J. and Dupre, K.
59 (2019) 'Visual discomfort and glare assessment in office environments: A review of
60 light-induced physiological and perceptual responses', *Building and Environment*, 153,
pp. 267-280.

1
2
3 Han, H. and Tai Kim, J. (2010) 'Application of high-density daylight for indoor
4 illumination', *Energy*, 35(6), pp. 2654-2666. doi: 10.1016/j.energy.2009.05.037.

5
6 Hassanain, M.A. (2007) 'Post-occupancy indoor environmental quality evaluation of
7 student housing facilities', *Architectural Engineering and Design Management*, 3(4),
8 pp. 249-256.

9
10
11 Hill, W.J. and Hunter, W.G. (1966) 'A review of response surface methodology: a
12 literature survey', *Technometrics*, 8(4), pp. 571-590.

13
14
15 Hirning, M.B., Isoardi, G.L., Coyne, S., Garcia Hansen, V.R. and Cowling, I. (2013)
16 'Post occupancy evaluations relating to discomfort glare: A study of green buildings in
17 Brisbane', *Building and Environment*, 59, pp. 349-357. doi:
18 10.1016/j.buildenv.2012.08.032.

19
20
21 Hopkinson, R.G., Petherbridge, P. and Longmore, J. (1966) *Daylighting*. Heinemann.

22
23 Hua, Y., Oswald, A. and Yang, X. (2011) 'Effectiveness of daylighting design and
24 occupant visual satisfaction in a LEED Gold laboratory building', *Building and
25 Environment*, 46(1), pp. 54-64. doi: 10.1016/j.buildenv.2010.06.016.

26
27
28 Humphreys, M.A. (2005) 'Quantifying occupant comfort: are combined indices of the
29 indoor environment practicable?', *Building Research & Information*, 33(4), pp. 317-
30 325. doi: 10.1080/09613210500161950.

31
32
33 Humphreys, M.A. and Nicol, J.F. (2000) 'Outdoor temperature and indoor thermal
34 comfort: Raising the precision of the relationship for the 1998 ASHRAE database of
35 field studies/Discussion', *ASHRAE Transactions*, 106, pp. 485.

36
37
38 Kaushik, A., Arif, M., Tumula, P. and Ebohon, O.J. (2020) 'Effect of thermal comfort
39 on occupant productivity in office buildings: response surface analysis', *Building and
40 Environment*, 180, pp. 107021.

41
42
43 Kent, M. and Schiavon, S. (2020) 'Evaluation of the effect of landscape distance seen
44 in window views on visual satisfaction', *Building and Environment*, 183, pp. 107160.

45
46
47 Kirk, R.E. (2012) 'Experimental design', *Handbook of Psychology, Second Edition*, 2.

48
49
50 Kittler, R., Hayman, S., Ruck, N. and Julian, W. (1992) 'Daylight measurement data:
51 Methods of evaluation and representation', *Lighting Research & Technology*, 24(4),
52 pp. 173-187.

53
54
55 Knoop, M., Stefani, O., Bueno, B., Matusiak, B., Hobday, R., Wirz-Justice, A., Martiny,
56 K., Kantermann, T., Aarts, M. and Zemmouri, N. (2020) 'Daylight: What makes the
57 difference?', *Lighting Research & Technology*, 52(3), pp. 423-442.

58
59
60 Kong, Z., Utzinger, D.M., Freihoefer, K. and Steege, T. (2018) 'The impact of interior
design on visual discomfort reduction: a field study integrating lighting environments
with POE survey', *Building and Environment*, 138, pp. 135-148.

1
2
3 Lai, A.C.K., Mui, K.W., Wong, L.T. and Law, L.Y. (2009) 'An evaluation model for
4 indoor environmental quality (IEQ) acceptance in residential buildings', *Energy and*
5 *Buildings*, 41(9), pp. 930-936. doi: <http://dx.doi.org/10.1016/j.enbuild.2009.03.016>.

6
7
8 Li, D.H.W. (2010) 'A review of daylight illuminance determinations and energy
9 implications', *Applied Energy*, 87(7), pp. 2109-2118.

10
11 Li, D.H.W. and Lam, J.C. (2001) 'Evaluation of lighting performance in office buildings
12 with daylighting controls', *Energy and Buildings*, 33(8), pp. 793-803. doi:
13 [http://dx.doi.org/10.1016/S0378-7788\(01\)00067-6](http://dx.doi.org/10.1016/S0378-7788(01)00067-6).

14
15
16 Li, D.H.W. and Tsang, E.K.W. (2008) 'An analysis of daylighting performance for office
17 buildings in Hong Kong', *Building and Environment*, 43(9), pp. 1446-1458. doi:
18 <http://dx.doi.org/10.1016/j.buildenv.2007.07.002>.

19
20
21 Lim, Y., Kandar, M.Z., Ahmad, M.H., Ossen, D.R. and Abdullah, A.M. (2012) 'Building
22 façade design for daylighting quality in typical government office building', *Building and*
23 *Environment*, 57, pp. 194-204. doi: <http://dx.doi.org/10.1016/j.buildenv.2012.04.015>.

24
25
26 Lin, Z. and Deng, S. (2008) 'A study on the thermal comfort in sleeping environments
27 in the subtropics—Developing a thermal comfort model for sleeping environments',
28 *Building and Environment*, 43(1), pp. 70-81. doi:
29 <http://dx.doi.org/10.1016/j.buildenv.2006.11.026>.

30
31
32 Lipczynska, A., Schiavon, S. and Graham, L.T. (2018) 'Thermal comfort and self-
33 reported productivity in an office with ceiling fans in the tropics', *Building and*
34 *Environment*, 135, pp. 202-212.

35
36
37 Lottrup, L., Stigsdotter, U.K., Meilby, H. and Claudi, A.G. (2015) 'The workplace
38 window view: a determinant of office workers' work ability and job satisfaction',
39 *Landscape Research*, 40(1), pp. 57-75.

40
41
42 Manning, M.A. (2006) 'An Experimental Evaluation and Comparison of Four
43 Daylighting Strategies for Schools in North Carolina', .

44
45
46 Mansfield, K.P. (2018) 'Architectural lighting design: A research review over 50 years',
47 *Lighting Research & Technology*, 50(1), pp. 80-97.

48
49
50 Mawson, A. (2002) 'The workplace and its impact on productivity', *Advanced*
51 *Workplace Associates*, London, .

52
53
54 Mujan, I., Anđelković, A.S., Munćan, V., Kljajić, M. and Ružić, D. (2019) 'Influence of
55 indoor environmental quality on human health and productivity-A review', *Journal of*
56 *Cleaner Production*, 217, pp. 646-657.

57
58
59 Myers, R.H., Montgomery, D.C. and Anderson-Cook, C.M. (2016) *Response surface*
60 *methodology: process and product optimisation using designed experiments*. John
Wiley & Sons.

1
2
3 Nagy, E., Yasunaga, S. and Kose, S. (1995) 'Japanese office employees'
4 psychological reactions to their underground and above-ground offices', *Journal of*
5 *Environmental Psychology*, 15(2), pp. 123-134.

6
7
8 Ne'Eman, E. and Hopkinson, R.G. (1970) 'Critical minimum acceptable window size:
9 a study of window design and provision of a view', *Lighting Research & Technology*,
10 2(1), pp. 17-27.

11
12 Nicol, J.F. and Humphreys, M.A. (2002) 'Adaptive thermal comfort and sustainable
13 thermal standards for buildings', *Energy and Buildings*, 34(6), pp. 563-572.

14
15 Omer, A.M. (2008) 'Energy, environment and sustainable development', *Renewable*
16 *and Sustainable Energy Reviews*, 12(9), pp. 2265-2300. doi:
17 10.1016/j.rser.2007.05.001.

18
19
20 Osibona, O., Solomon, B.D. and Fecht, D. (2021) 'Lighting in the Home and Health: A
21 Systematic Review', *International journal of environmental research and public health*,
22 18(2), pp. 609.

23
24
25 Peretti, C. and Schiavon, S. (2011) 'Indoor environmental quality surveys. A brief
26 literature review', .

27
28
29 Rea, M.S., Figueiro, M.G. and Bullough, J.D. (2002) 'Circadian photobiology: An
30 emerging framework for lighting practice and research', *Lighting Research and*
31 *Technology*, 34(3), pp. 177-187.

32
33 Rea, M.S. (2000) 'The IESNA lighting handbook: reference & application', .

34
35
36 Reinhart, C.F., Mardaljevic, J. and Rogers, Z. (2006) 'Dynamic daylight performance
37 metrics for sustainable building design', *Leukos*, 3(1), pp. 7-31.

38
39 Romm, J. and Browning, W. (1994) *Greening the Building and the Bottom Line -*
40 *Increasing productivity through energy-efficient design*. Rocky Mountain Institute.
41 Available at:(Accessed: .

42
43
44 Rubin, A.I., Collins, B.L. and Tibbott, R.L. (1978) 'Window blinds as potential energy
45 saver—a case study, NBS Building Science Series, vol. 112', *National Institute for*
46 *Standards and Technology, Gaithersburg, MA, USA*, .

47
48
49 Shindler, R. (2019) 'Investing in Better Outcomes: The Impact of Daylight in the Built
50 Environment', .

51
52 Słomiński, S. and Krupiński, R. (2018) 'Luminance distribution projection method for
53 reducing glare and solving object-floodlighting certification problems', *Building and*
54 *Environment*, 134, pp. 87-101.

55
56 Steffy, G. (2002) *Architectural lighting design*. John Wiley & Sons.

57
58
59 Stein, B., Reynolds, J.S. and McGuinness, W.J. (1992) *Mechanical and electrical*
60 *equipment for buildings*. J. Wiley & Sons.

1
2
3 Tabachnick, B.G. and Fidell, L.S. (2007) *Experimental designs using ANOVA*.
4 Thomson/Brooks/Cole Belmont, CA.
5

6
7 Turan, I., Chegut, A., Fink, D. and Reinhart, C. (2020) 'The value of daylight in office
8 spaces', *Building and Environment*, 168, pp. 106503.
9

10
11 Van Den Wymelenberg, K. and Inanici, M. (2014) 'A critical investigation of common
12 lighting design metrics for predicting human visual comfort in offices with daylight',
13 *Leukos*, 10(3), pp. 145-164.
14

15
16 Wong, L., Caddick, Z., Kuriyagawa, Y. and Flynn-Evans, E. (2017) 'The Effects of
17 Primary Light Sources on Worker Performance and Alertness', .
18

19
20 Wotton, E. (1982) *An investigation of the effects of windows and lighting in offices*.
21 Health and Welfare Canada.
22

23
24 Ximénez, M.C. and San Martín, R. (2000) 'Application of response surface
25 methodology to the study of person-organisation fit', *Psicothema*, 12(1), pp. 151-158.
26

27
28 Yang, I. and Nam, E. (2010) 'Economic analysis of the daylight-linked lighting control
29 system in office buildings', *Solar Energy*, 84(8), pp. 1513-1525. doi:
30 10.1016/j.solener.2010.05.014.
31

32
33 Yildirim, K., Akalin-Baskaya, A. and Celebi, M. (2007) 'The effects of window proximity,
34 partition height, and gender on perceptions of open-plan offices', *Journal of
35 Environmental Psychology*, 27(2), pp. 154-165. doi:
36 <http://dx.doi.org/10.1016/j.jenvp.2007.01.004>.
37

38
39 Yun, G.Y., Kong, H.J., Kim, H. and Kim, J.T. (2012) 'A field survey of visual comfort
40 and lighting energy consumption in open plan offices', *Energy and Buildings*, 46, pp.
41 146-151.
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60